


ACCEPTABLE CORPORATION STOPS

1. A.Y. McDONALD 74701-B
2. FORD FB600-NL
3. MUELLER B-25000N
4. OR APPROVED EQUAL.

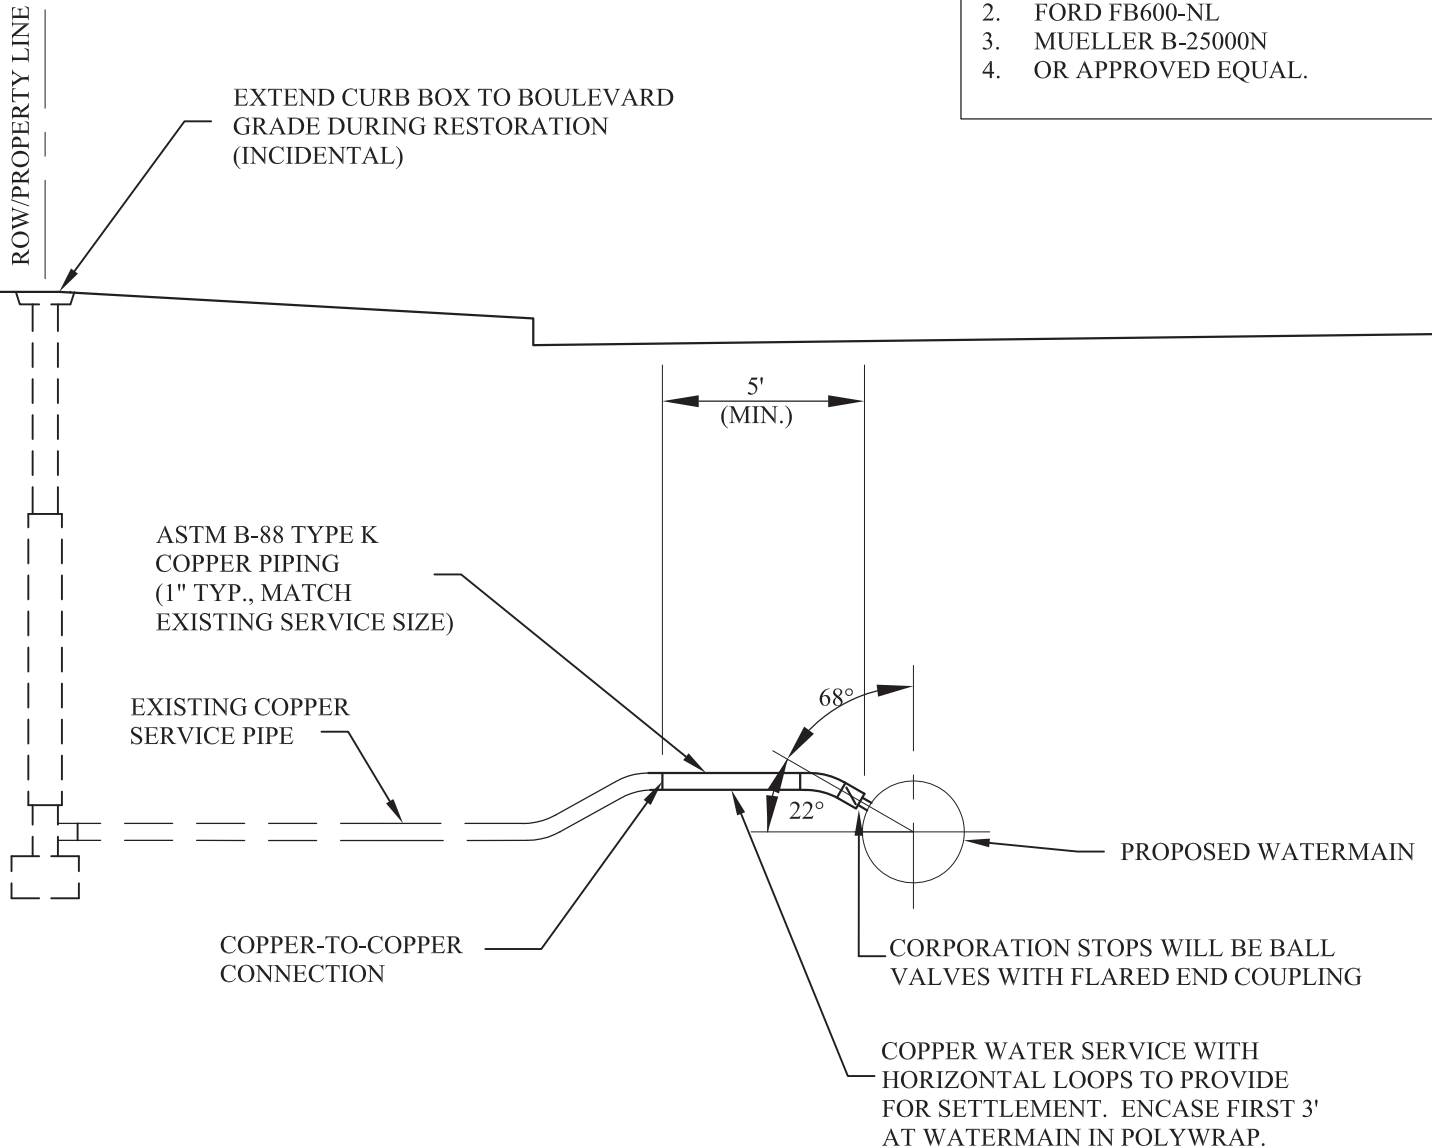

NOTES

1. MAINTAIN 18" VERTICAL AND 24" HORIZONTAL SEPARATION BETWEEN SEWER AND WATER SERVICE LINES.
2. CONNECTION TO EXISTING WATER SERVICE WILL BE MADE AT 5' (MIN.) FROM CORPORATION STOP.



CITY OF BURNSVILLE - ENGINEERING DEPT.
**EXISTING WATER
 SERVICE CONNECTION**

Plate No.	WM-3
Revision Date	11/2013
File Location: S:\Details\english\Watermain\WM03-Service Replace.dwg	