




#### NOTES

1. ALL DROP COMPONENTS (BENDS, TEES, VERTICAL DUCTILE IRON PIPE, PRECAST HORSESHOES, MORTAR, CONNECTIONS TO EXISTING STRUCTURES, AND IF APPLICABLE, REMOVAL OF THE EXISTING DROP SECTION) ARE CONSIDERED INCIDENTAL TO THE "OUTSIDE DROP" BID ITEM.
2. "KOR-N-SEAL" OR APPROVED EQUIVALENT GASKETED BOOT CONNECTION WILL BE USED FOR CONNECTING PIPE TO MANHOLE FOR PRECAST SECTIONS (SEE DETAIL SS-4).
3. ALL CONNECTIONS TO EXISTING STRUCTURES WILL BE CORE DRILLED.
4. ECCENTRIC CONE WILL BE OFFSET TO THE OUTLET (LOWEST) INVERT SIDE.
5. REFER TO DIVISION 2, PART B, SECTION 2621.3.D.1 FOR ADDITIONAL CONSTRUCTION REQUIREMENTS.
6. REFER TO DIVISION 2, PART A, SECTION 2503.4.C FOR METHOD OF MEASUREMENT.

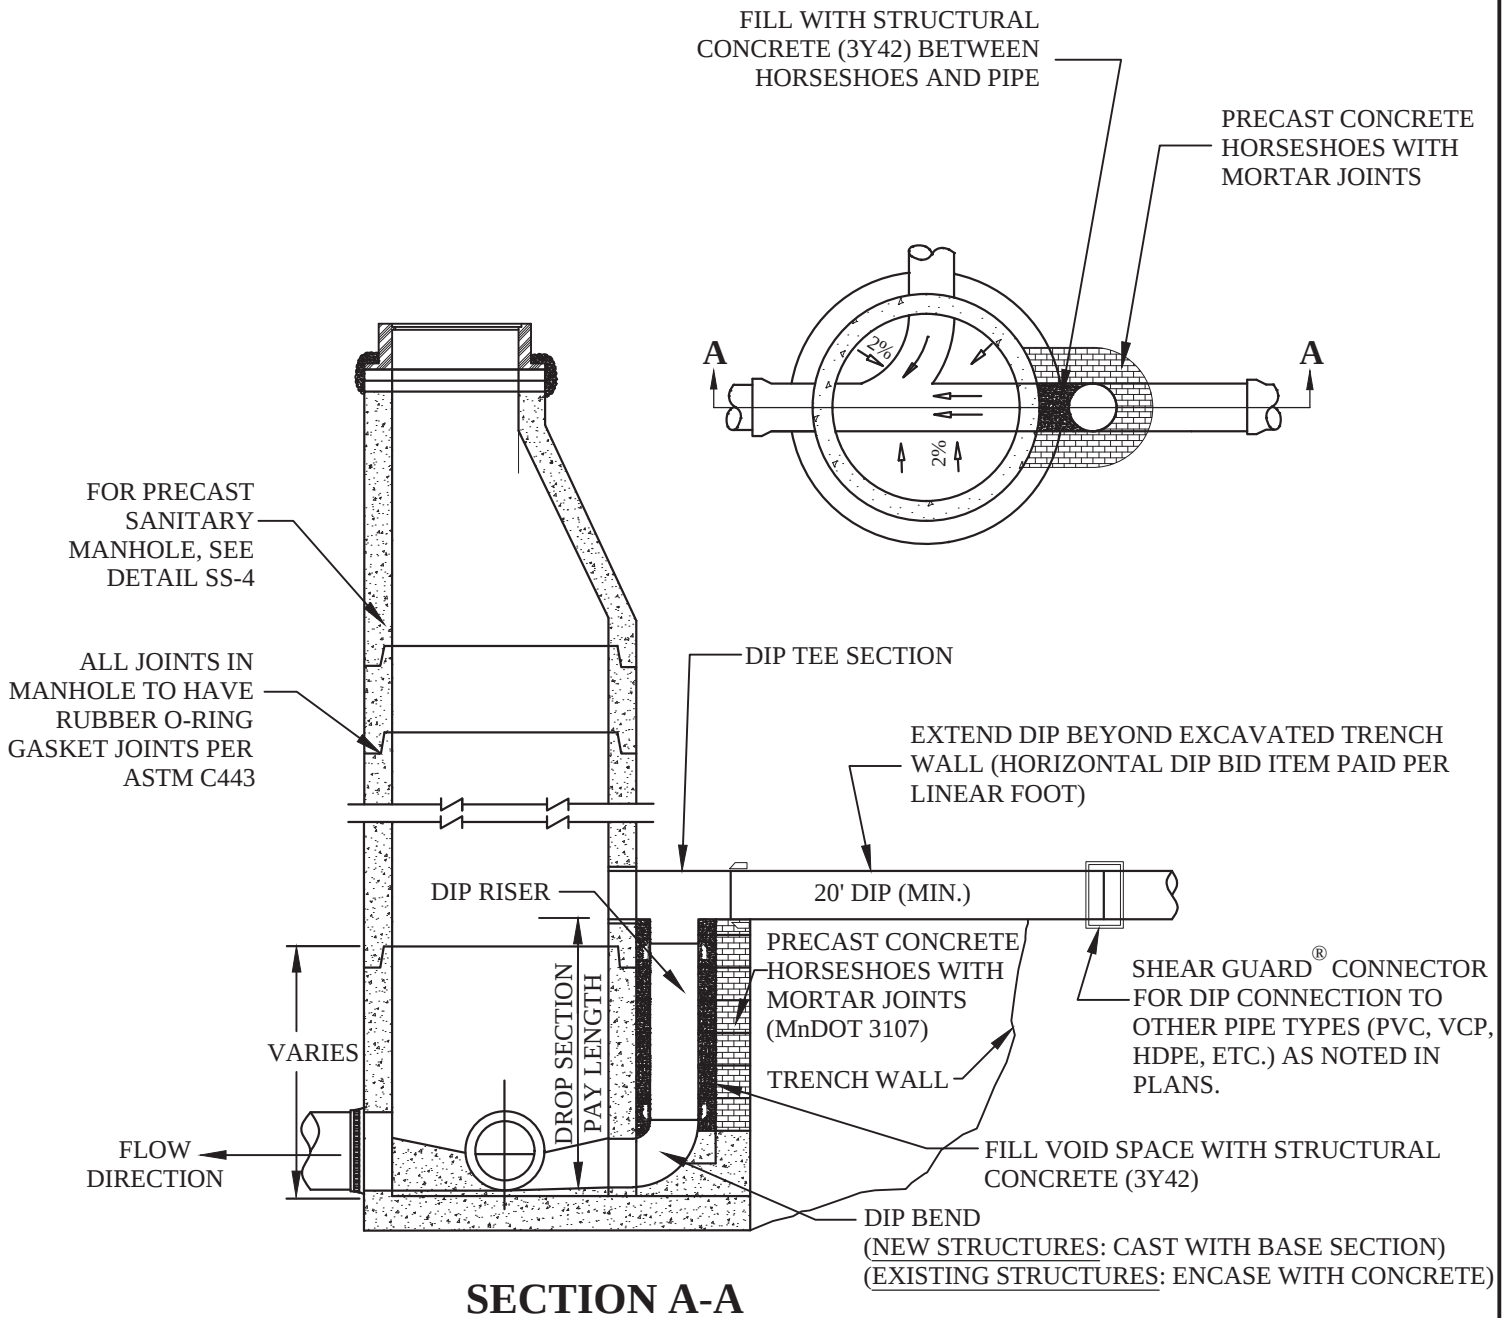

CITY OF BURNSVILLE - ENGINEERING DEPT.

## SANITARY SEWER OUTSIDE DROP SECTION

Plate No.

SS-5

Revision Date

1/2018

File Location:

S:\Details\english\Sanitary Sewer\SS05-Outside Drop MH.dwg